



**TOWN OF AMHERST**  
**Fire Safety Division**


5583 Main St – Lower Level  
 Amherst, New York 14221  
 Phone (716) 631-7140  
 Email: [firesafety@amherst.ny.us](mailto:firesafety@amherst.ny.us)  
[www.amherst.ny.us/firesafety](http://www.amherst.ny.us/firesafety)

**TRUSS ID SIGNAGE – COMMERCIAL**  
**(QUICK REFERENCE)**

*This is to provide guidance for the requirements of the construction of each new commercial structure and to each addition to or rehabilitation of an existing commercial structure in compliance with the Building Code of New York State and 19 CRR-NY Part 1264.*

This is a quick reference on the location of Truss ID Signage in compliance with Part 1264, which pertains to all structures except those listed in R101.2 of the Residential Code. *This is not Part 1264 in its entirety.*

Sign location	Sign placement
Exterior building entrance doors, exterior exit discharge doors, and exterior roof access doors to a stairway	Attached to the door, or attached to a sidelight or the face of the building, not more than 12 inches (305 mm) horizontally from the latch side of the door jamb, and not less than 42 inches (1,067 mm) nor more than 60 inches (1,524 mm) above the adjoining walking surface
Multiple contiguous exterior building entrance or exit discharge doors	Attached at each end of the row of doors and at a maximum horizontal distance of 12 feet (3.65 m) between signs, and not less than 42 inches (1,067 mm) nor more than 60 inches (1,524 mm) above the adjoining walking surface
Fire department hose connections	Attached to the face of the building, not more than 12 inches (305 mm) horizontally from the center line of the fire department hose connection, and not less than 42 inches (1,067 mm) nor more than 60 inches (1,524 mm) above the adjoining walking surface

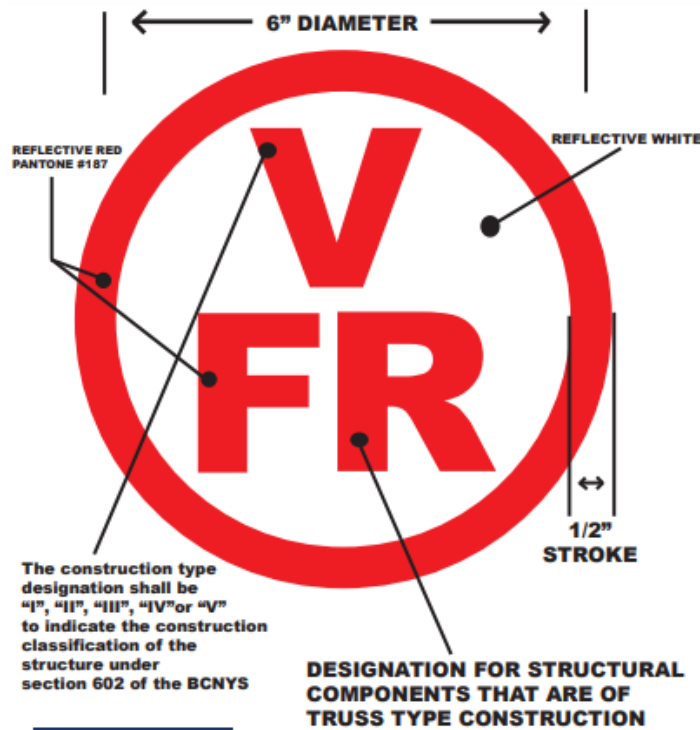

"I"	FLOOR FRAMING, INCLUDING GIRDERS AND BEAMS
"R"	ROOF FRAMING
"FR"	FLOOR AND ROOF FRAMING